Please note: This drawing shows a typical configuration of equipment and does not necessarily show the equipment currently installed in the unit. Verify the specific equipment currently in the unit with a KTG representative.

THE DESIGN AND DETAILS DISCLOSED HEREIN ARE THE EXCLUSIVE PROPERTY OF CARLIN MANUFACTURING LLC. AND SHALL NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR WRITTEN CONSENT OF CARLIN MANUFACTURING LLC. © 2005 CARLIN MANUFACTURING LLC.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

NOTES:
1. USE 1/2" KITEK. TO PLUMB WATER LINE UNLESS OTHERWISE SPECIFIED
2. ALL LINES SHALL BE ADEQUATELY SUPPORTED WITH GALV. STL. 2 HOLE STRAPS AT 3' O.C. MAX. TO WITHSTAND NORMAL ROAD AND OFF-ROAD (ROUGH TERRAIN) CONDITIONS.
3. ALWAYS USE ROUND RUBBER GROMMETS WHENEVER PLUMBING LINES RUN THRU METAL PLATES, SKIN, CURB, ETC.
4. WRAP HOT WATER LINE W/ 3/8 WALL RUBATEX (NEOPRENE) PIPE INSULATION.
5. PRESSURE TEST WATER LINES (90-100 PSI) FOR LEAKS PRIOR TO EQUIPMENT FINAL CONNECTIONS.

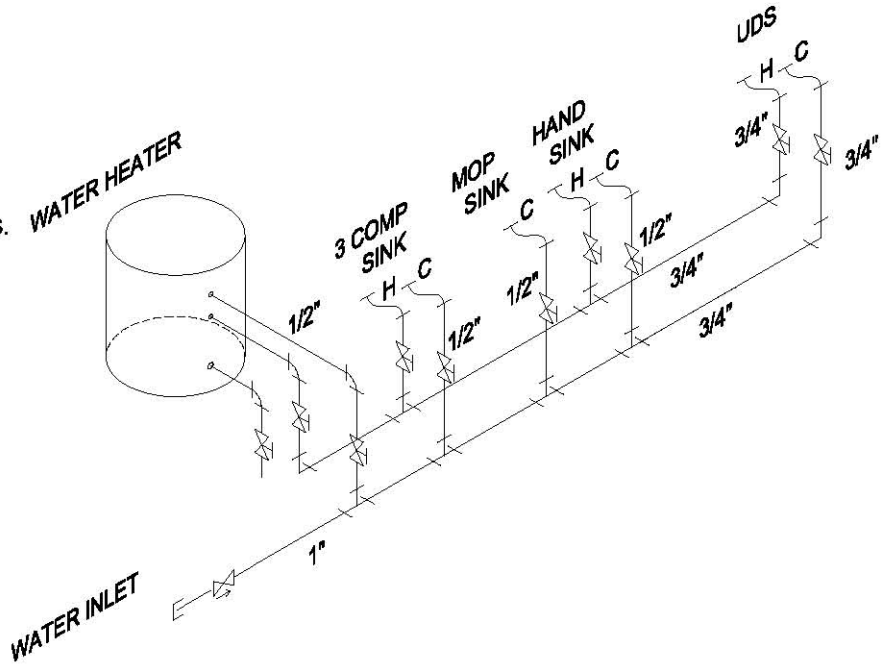

SYMBOL	DESCRIPTION
H	HOT WATER LINE
C	COLD WATER LINE
R	PRESSURE REGULATOR
	VALVE, BRASS BALL
	TEE
	90° ELBOW
	FLEX HOSE ASSEMBLY (S.S. BRAIDED MPT x FPT SWIVEL)
	QUICK DISCONNECT
	VALVE 3-WAY
	PUMP
	REDUCER
	CHECK VALVE
	WATER FILTRATION SYSTEM

Kitchens To Go

KTG-551
MODULAR KITCHEN UNIT

SIZE	CAGE CODE	DWG. NO.	REV.
B		551P01-0-01	

SCALE 1:4 | DO NOT SCALE DRAWING | DRAWINGS PREPARED IN ACCORDANCE WITH MIL-T-31000, MIL-STD-100, AND ANSI Y14.8

KTG-551

APPROVALS	DATE
DRAWN GSF	08-24-05
CHECKED	
ENGR.	
DESIGN ACTIVITY	
REV.	

CARLIN MANUFACTURING, LLC.

FRESH WATER
PLUMBING SCHEMATIC

SIZE	CAGE CODE	DWG. NO.	REV.
B		551P01-0-01	

SCALE 1:4