Please note: This drawing shows a typical configuration of equipment and does not necessarily show the equipment currently installed in the unit. Verify the specific equipment currently in the unit with a KTG representative.

THE DESIGN AND DETAILS DISCLOSED HEREIN ARE THE EXCLUSIVE PROPERTY OF CARLIN MANUFACTURING LLC. AND SHALL NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR WRITTEN CONSENT OF CARLIN MANUFACTURING LLC. © 2005 CARLIN MANUFACTURING LLC.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

NOTES:
1. USE 1/2" KITEK. TO PLUMB WATER LINE UNLESS OTHERWISE SPECIFIED
2. ALL LINES SHALL BE ADEQUATELY SUPPORTED WITH GALV. STL. 2 HOLE STRAPS AT 3' O.C. MAX.
3. ALWAYS USE ROUND RUBBER GROMMETS WHENEVER PLUMBING LINES RUN THRU METAL PLATES, SKIN, CURB, ETC.
4. WRAP HOT WATER LINE W/ 3/8 WALL RUBATEX (NEOPRENE) PIPE INSULATION.
5. PRESSURE TEST WATER LINES (90-100 PSI) FOR LEAKS PRIOR TO EQUIPMENT FINAL CONNECTIONS.

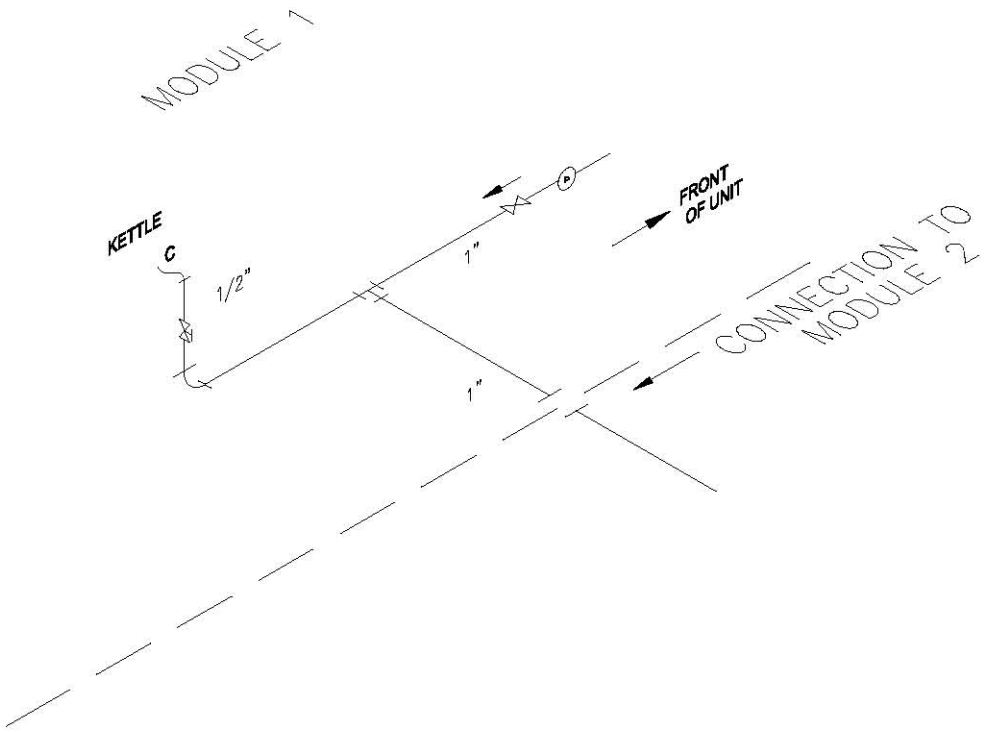

SYMBOL	DESCRIPTION
H	HOT WATER LINE
C	COLD WATER LINE
R	PRESSURE REGULATOR
	VALVE, BRASS BALL
	TEE
	90° ELBOW
	FLEX HOSE ASSEMBLY (S.S. BRAIDED MPT x FPT SWIVEL)
	QUICK DISCONNECT
	VALVE 3-WAY
	PUMP
	REDUCER
	CHECK VALVE
	WATER FILTRATION SYSTEM

Kitchens To Go

KTG-553
MODULAR KITCHEN UNIT

SIZE	CAGE CODE	DWG. NO.	REV.
B		553P01-0-01	

SCALE 1:1 | DRG WT. | ACT. WT. | SHEET

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES
TOLERANCES ARE:
FRACTIONS ± 1/16 | DECIMALS .XX ± .03 | ANG ± 2° | .XXX ± .005
DO NOT SCALE DRAWING
DRAWINGS PREPARED IN ACCORDANCE WITH MIL-T-31000, MIL-STD-100, AND ANSI Y14.5
SIMILAR TO

KTG-553

	APPROVALS	DATE
DRAWN	GSF	08-24-05
CHECKED		
ENGR.		
DESIGN ACTIVITY		
REV.		

CARLIN MANUFACTURING, LLC.

FRESH WATER
PLUMBING SCHEMATIC

SIZE	CAGE CODE	DWG. NO.	REV.
B		553P01-0-01	

SCALE 1:1 | DRG WT. | ACT. WT. | SHEET