


Please note: This drawing shows a typical configuration of equipment and does not necessarily show the equipment currently installed in the unit. Verify the specific equipment currently in the unit with a KTG representative.

THE DESIGN AND DETAILS DISCLOSED HEREIN ARE THE EXCLUSIVE PROPERTY OF CARLIN MANUFACTURING LLC. AND SHALL NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR WRITTEN CONSENT OF CARLIN MANUFACTURING LLC. © 2005 CARLIN MANUFACTURING LLC.

REVISIONS			
DATE	REV	DESCRIPTION	APPROVED

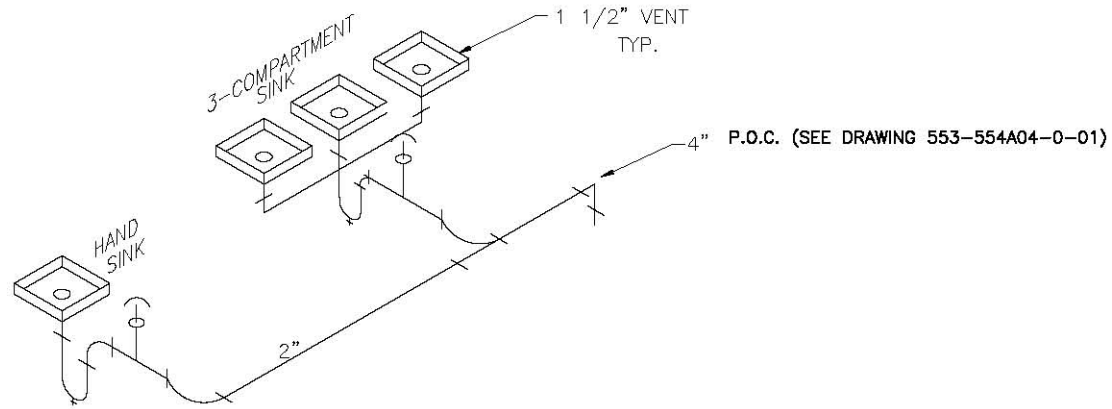

**NOTES AND SPECIFICATIONS:**

- SEWER LINES FROM FLOOR SINKS SHALL ALL BE CAST IRON (C.I.) EXCEPT VENT LINES, OTHERWISE USE ABS MATERIAL.
- FLOOR SINKS SHALL BE MOUNTED FLUSH WITH THE FINISHED FLOOR.
- WASTE LINES SHALL BE SUPPORTED WITH PIPE STRAPS AT 3' O.C. MAX.

SYMBOL	DESCRIPTION
	P-TRAP W/C.D.
	FLOOR SINK
	SINK
	DISPOSER, GARBAGE
	TEE/WYE LONG RADIUS
	ELBOW 90°
	VENT LINE
	VENT LINE THROUGH ROOF
	CONDENSATE RECEPTOR
	SINK VENT

**Kitchens To Go**

**KTG-554**  
MODULAR KITCHEN UNIT

SIZE: <b>B</b>	DATE CODE: 554P02-0-01	REV:
SCALE: 1:1	DWG. NO. 554P02-0-01	REV.

DO NOT SCALE DRAWINGS

DESIGNED BY:  

CHECKED BY:  

DATE:  

SCALE: 1:1

**KTG-554**

**CARLIN**  
MANUFACTURING LLC.

**WASTE WATER PLUMBING SCHEMATIC**

APPROVALS: GSF	DATE: 08-24-05
SIZE: <b>B</b>	DATE CODE: 554P02-0-01
SCALE: 1:1	REV.