


Please note: This drawing shows a typical configuration of equipment and does not necessarily show the equipment currently installed in the unit. Verify the specific equipment currently in the unit with a KTG representative.

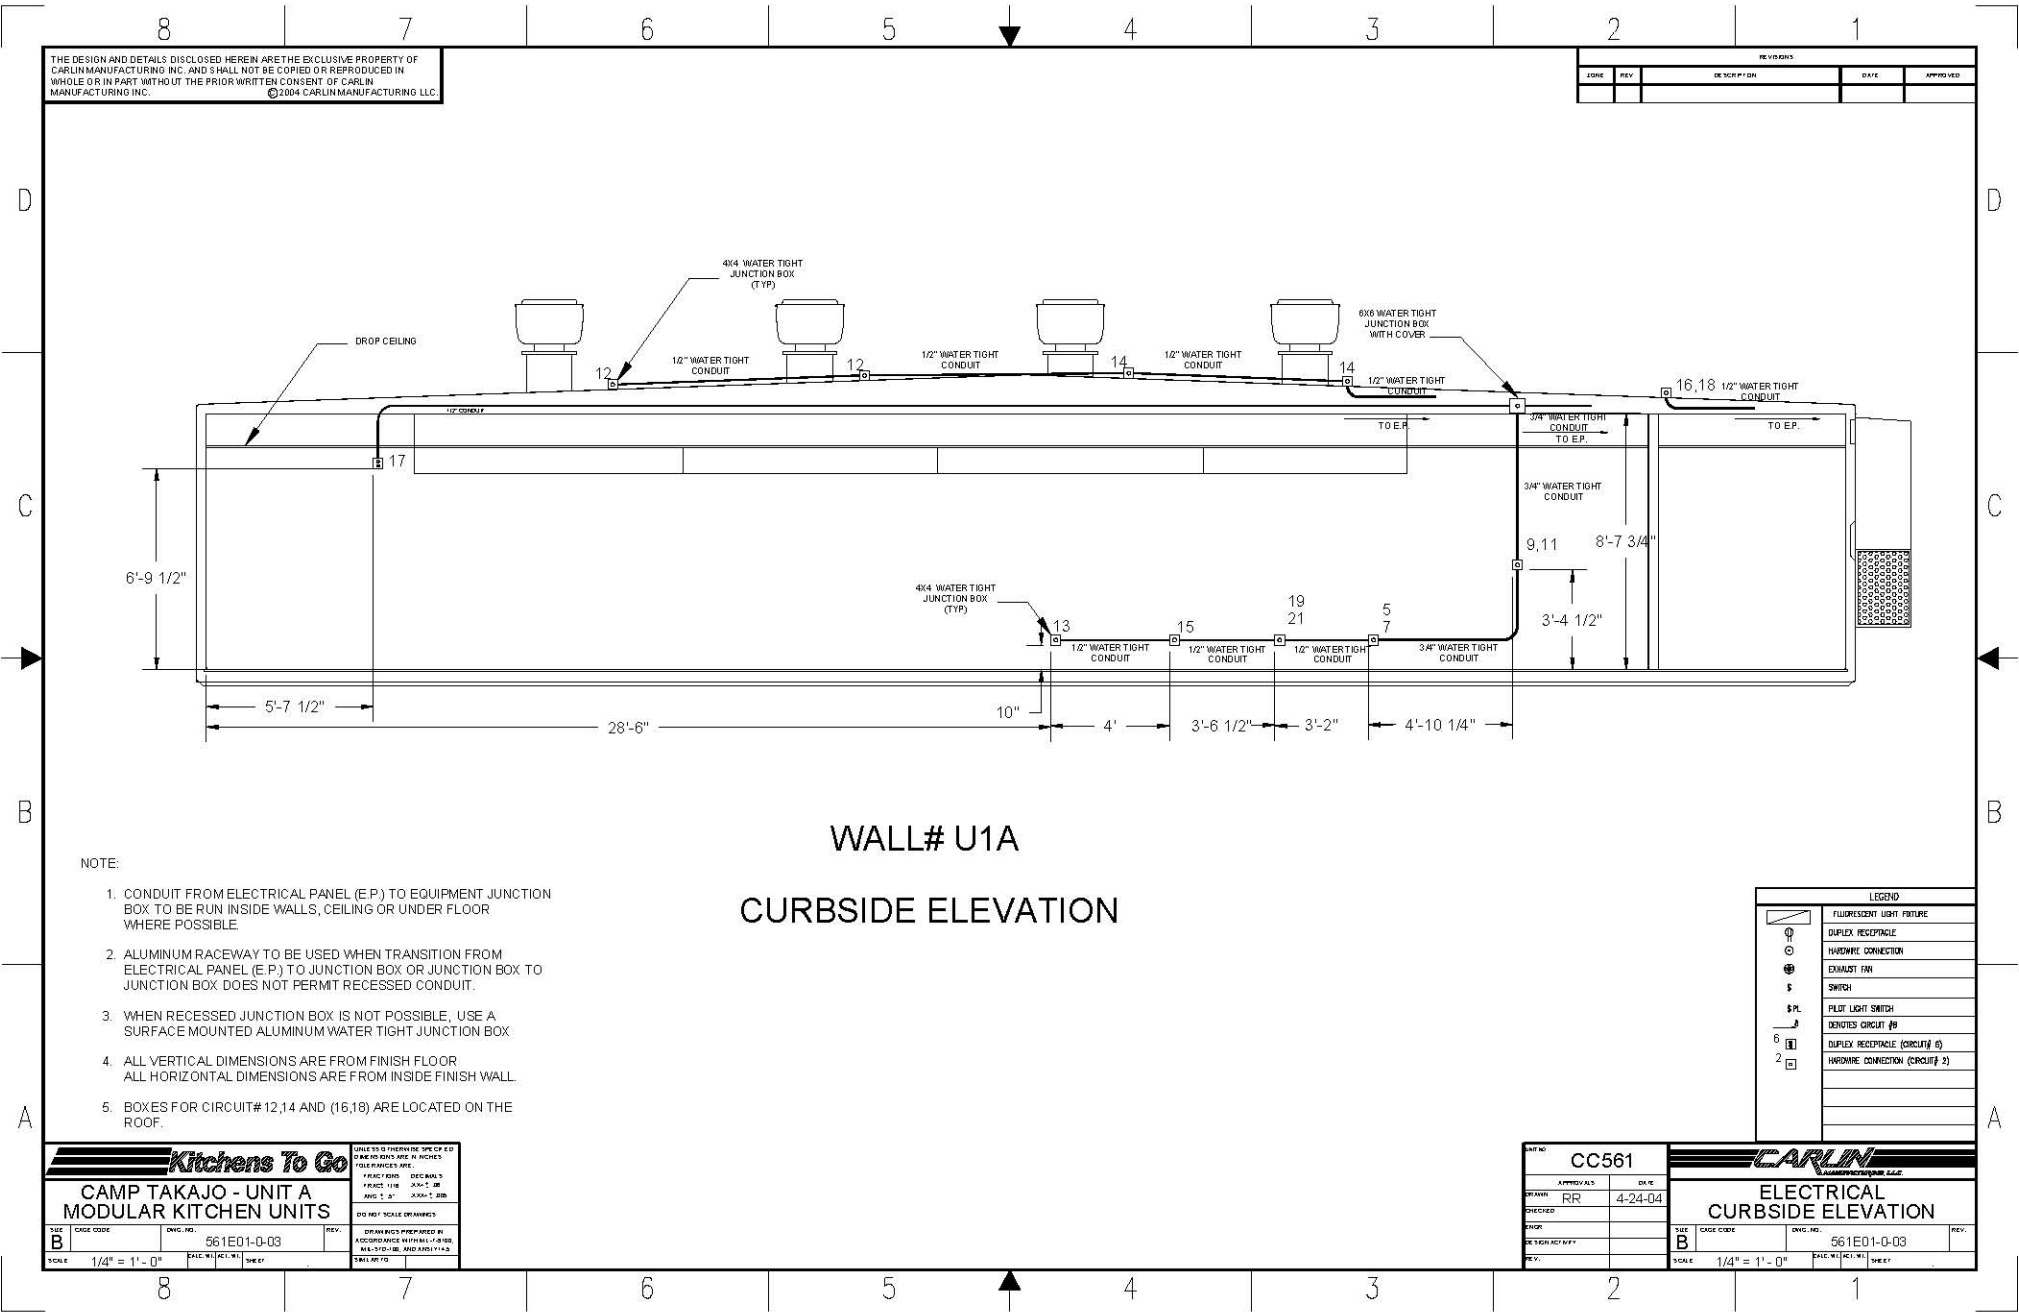

THE DESIGN AND DETAILS DISCLOSED HEREIN ARE THE EXCLUSIVE PROPERTY OF CARLIN MANUFACTURING INC. AND SHALL NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR WRITTEN CONSENT OF CARLIN MANUFACTURING INC. ©2004 CARLIN MANUFACTURING LLC.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

- NOTE:
1. CONDUIT FROM ELECTRICAL PANEL (E.P.) TO EQUIPMENT JUNCTION BOX TO BE RUN INSIDE WALLS, CEILING OR UNDER FLOOR WHERE POSSIBLE
 2. ALUMINUM RACEWAY TO BE USED WHEN TRANSITION FROM ELECTRICAL PANEL (E.P.) TO JUNCTION BOX OR JUNCTION BOX TO JUNCTION BOX DOES NOT PERMIT RECESSED CONDUIT.
 3. WHEN RECESSED JUNCTION BOX IS NOT POSSIBLE, USE A SURFACE MOUNTED ALUMINUM WATER TIGHT JUNCTION BOX
 4. ALL VERTICAL DIMENSIONS ARE FROM FINISH FLOOR
ALL HORIZONTAL DIMENSIONS ARE FROM INSIDE FINISH WALL
 5. BOXES FOR CIRCUIT# 12,14 AND (16,18) ARE LOCATED ON THE ROOF.

LEGEND	
	FLUORESCENT LIGHT FIXTURE
	DUPLEX RECEPTACLE
	HARDWIRE CONNECTION
	EXHAUST FAN
	SWITCH
	PILOT LIGHT SWITCH
	DENOTES CIRCUIT #B
	DUPLEX RECEPTACLE (CIRCUIT# 6)
	HARDWIRE CONNECTION (CIRCUIT# 2)

Kitchens To Go		UNITS TO BE PROVIDED SPECIFIED TO ORDER ONLY WITH 4 HOURS. 10% PLACES ARE.	
CAMP TAKAJO - UNIT A MODULAR KITCHEN UNITS		PRICE CODE	DECISION'S
DATE	CAGE CODE	PRICE 118	DATE 08
B	561E01-0-03	ANG 1 21	J-KM-1 208
SCALE 1/4" = 1'-0"		DO NOT SCALE DIMENSIONS	
DRAWINGS PREPARED BY		DATE	
ACCORDANCE WITH		DATE	
REVISIONS		DATE	
SCALE		DATE	

UNIT NO. CC561		CARLIN MANUFACTURING LLC	
APPROVALS	DATE	ELECTRICAL CURBSIDE ELEVATION	
RR	4-24-04	SIZE B	
CHECKED		CAGE CODE	561E01-0-03
DESIGN		DATE	
DESIGN REVIEW		SCALE	1/4" = 1'-0"
REV.		DATE	