Please note: This drawing shows a typical configuration of equipment and does not necessarily show the equipment currently installed in the unit. Verify the specific equipment currently in the unit with a KTG representative.

THE DESIGN AND DETAILS DISCLOSED HEREIN ARE THE EXCLUSIVE PROPERTY OF CARLIN MANUFACTURING INC. AND SHALL NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR WRITTEN CONSENT OF CARLIN MANUFACTURING INC. ©2004 CARLIN MANUFACTURING LLC.

REVISIONS				
ZONE	REV.	DESCRIPTION	DATE	APPROVED

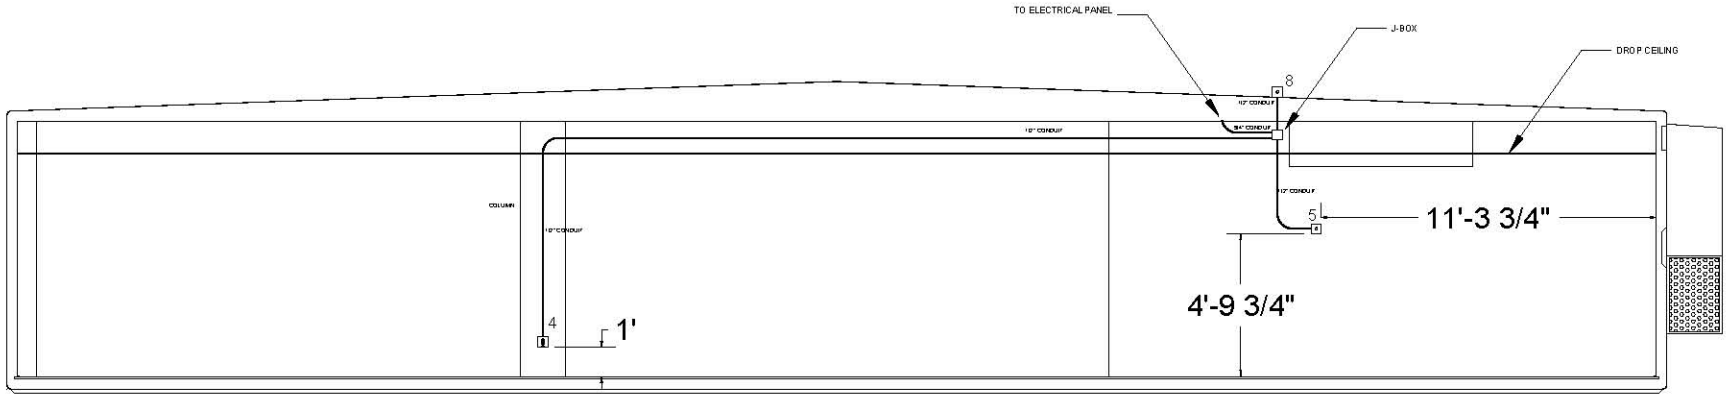

UNIT "C" CURBSIDE ELEVATION

NOTE:

1. CONDUIT FROM ELECTRICAL PANEL TO EQUIPMENT JUNCTION BOX TO BE RUN INSIDE WALLS, CEILING OR UNDER FLOOR WHERE POSSIBLE.
2. ALUMINUM RACEWAY TO BE USED WHEN TRANSITION FROM ELECTRICAL PANEL TO JUNCTION BOX OR JUNCTION BOX TO JUNCTION BOX DOES NOT PERMIT RECESSED CONDUIT.
3. WHEN RECESSED JUNCTION BOX IS NOT POSSIBLE, USE A SURFACE MOUNTED ALUMINUM WATER TIGHT JUNCTION BOX
4. ALL VERTICAL DIMENSIONS ARE FROM FINISH FLOOR ALL HORIZONTAL DIMENSIONS ARE FROM INSIDE FINISH WALL.
5. CIRCUIT#8 LOCATED ON THE ROOF.

LEGEND	
	FLUORESCENT LIGHT FIXTURE
	DUPLEX RECEPTACLE
	HARDWIRE CONNECTION
	EXHAUST FAN
$	SWITCH
$PL	PILOT LIGHT SWITCH
#8	DENOTES CIRCUIT #8
6	DUPLEX RECEPTACLE (CIRCUIT# 6)
2	HARDWIRE CONNECTION (CIRCUIT# 2)

Kitchens To Go

CAMP TAKAJO - UNIT C
MODULAR KITCHEN UNIT

SIZE	CAGE CODE	DWG. NO.	REV.
B		563E01-0-03	

SCALE 1/4" = 1'-0" | CALC. WT. | ACT. WT. | SHEET

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES ARE:
FRACTIONS DECIMALS
ANG ± .5° XXX ± .005
DO NOT SCALE DRAWINGS
DRAWINGS PREPARED IN ACCORDANCE WITH MIL-STD-100, MIL-STD-31B, AND ANSI Y14.5
SIMILAR TO

UNIT NO	CC563	
APPROVALS		DATE
DRAWN	RR	4-24-04
CHECKED		
ENGR		
DESIGN ACTIVITY		
REV.		

CARLIN COMBINATION LLC

ELECTRICAL
CURBSIDE ELEVATION

SIZE	CAGE CODE	DWG. NO.	REV.
B		563E01-0-03	

SCALE 1/4" = 1'-0" | CALC. WT. | ACT. WT. | SHEET