


Please note: This drawing shows a typical configuration of equipment and does not necessarily show the equipment currently installed in the unit. Verify the specific equipment currently in the unit with a KTG representative.

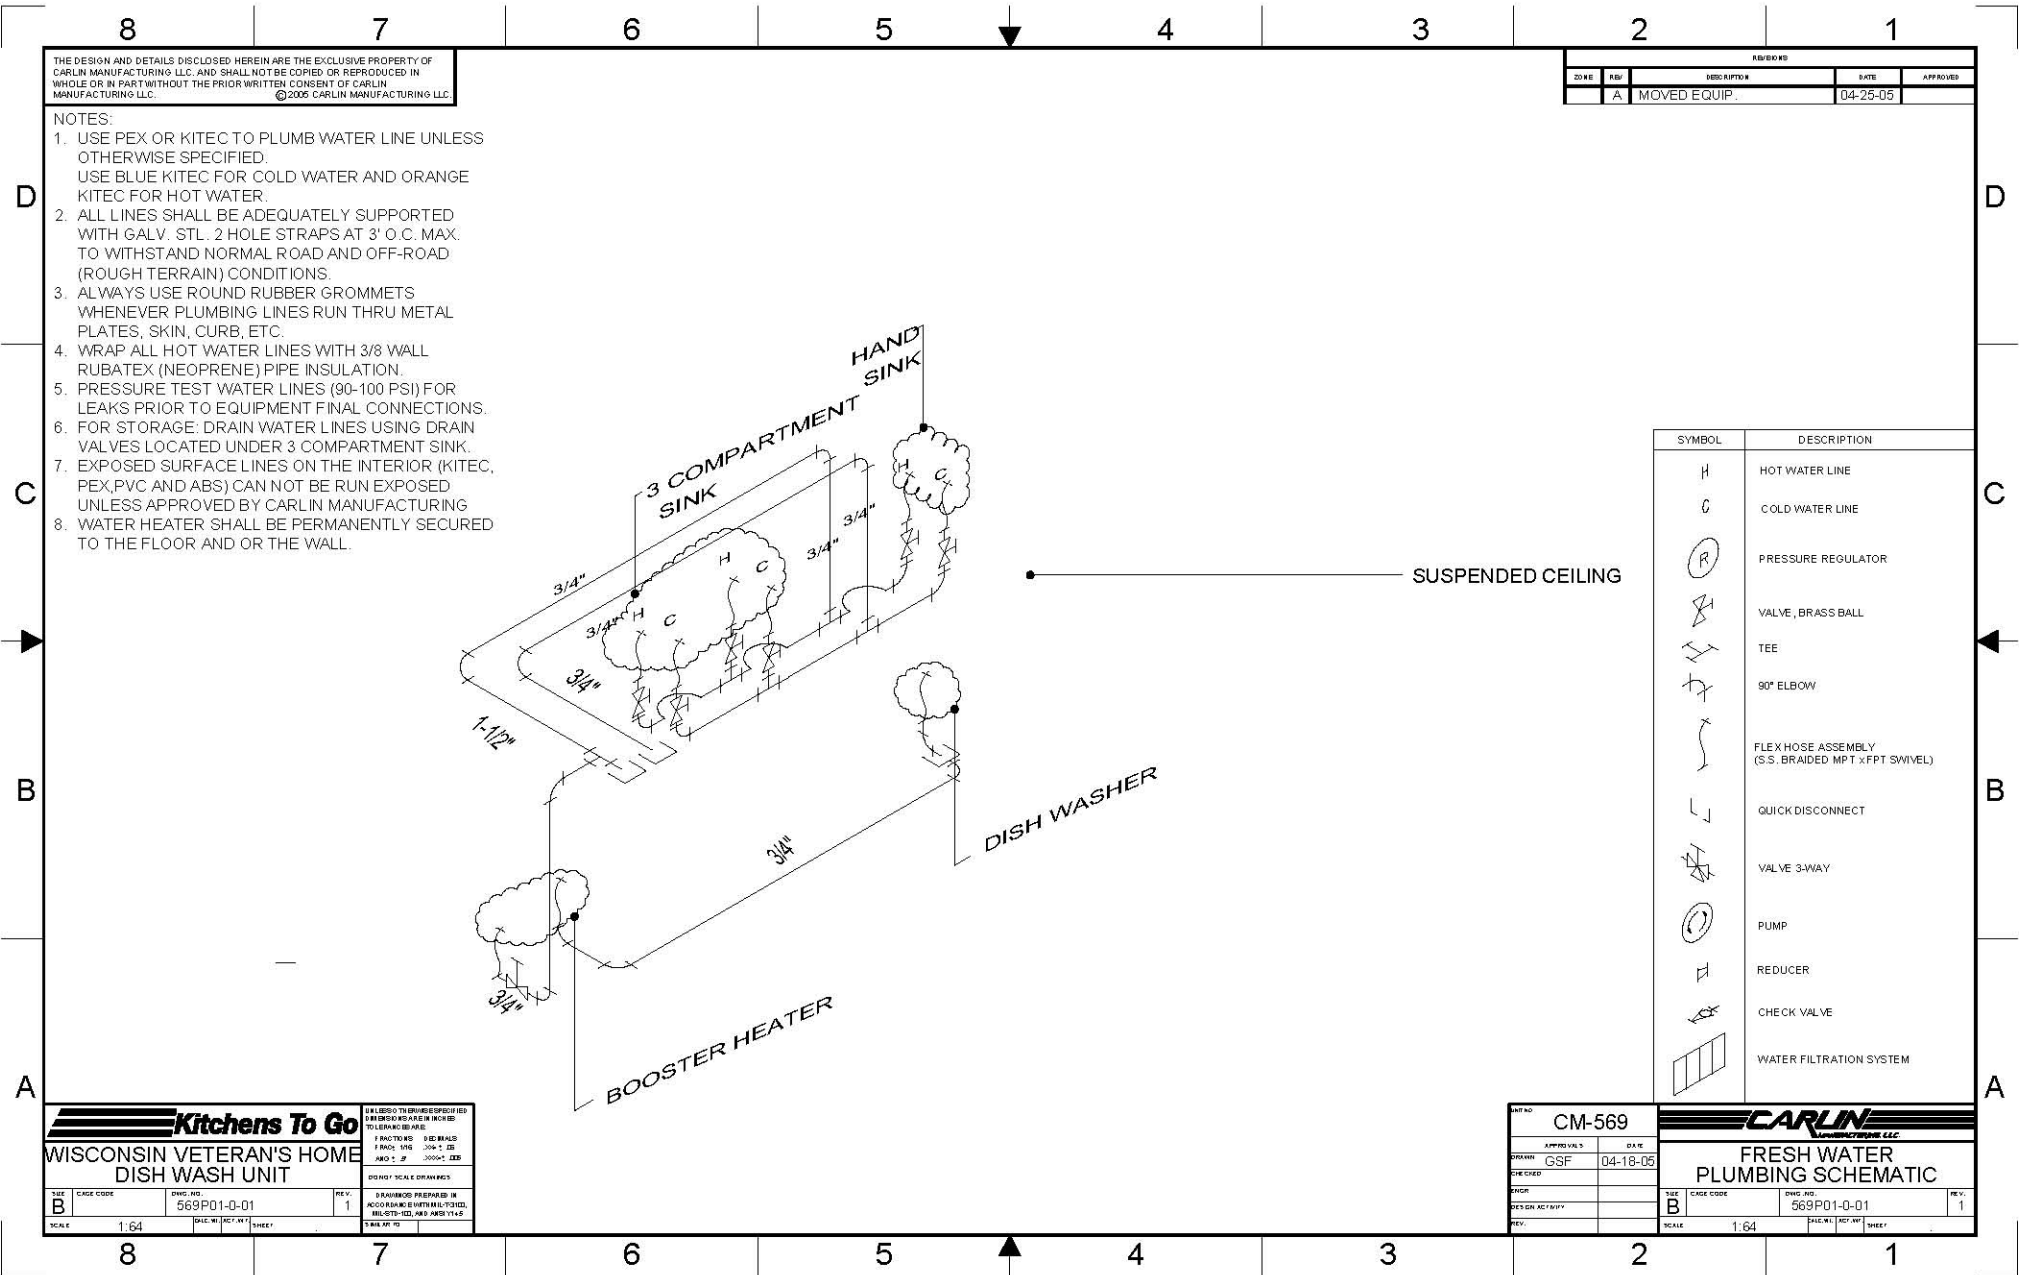

THE DESIGN AND DETAILS DISCLOSED HEREIN ARE THE EXCLUSIVE PROPERTY OF CARLIN MANUFACTURING LLC. AND SHALL NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR WRITTEN CONSENT OF CARLIN MANUFACTURING LLC. ©2005 CARLIN MANUFACTURING LLC.

DATE	REV	DESCRIPTION	DATE	APPROVED
	A	MOVED EQUIP.	04-25-05	

- NOTES:
1. USE PEX OR KITEC TO PLUMB WATER LINE UNLESS OTHERWISE SPECIFIED.  
USE BLUE KITEC FOR COLD WATER AND ORANGE KITEC FOR HOT WATER.
  2. ALL LINES SHALL BE ADEQUATELY SUPPORTED WITH GALV. STL. 2 HOLE STRAPS AT 3' O.C. MAX. TO WITHSTAND NORMAL ROAD AND OFF-ROAD (ROUGH TERRAIN) CONDITIONS.
  3. ALWAYS USE ROUND RUBBER GROMMETS WHENEVER PLUMBING LINES RUN THRU METAL PLATES, SKIN, CURB, ETC.
  4. WRAP ALL HOT WATER LINES WITH 3/8" WALL RUBATEX (NEOPRENE) PIPE INSULATION.
  5. PRESSURE TEST WATER LINES (90-100 PSI) FOR LEAKS PRIOR TO EQUIPMENT FINAL CONNECTIONS.
  6. FOR STORAGE, DRAIN WATER LINES USING DRAIN VALVES LOCATED UNDER 3 COMPARTMENT SINK.
  7. EXPOSED SURFACE LINES ON THE INTERIOR (KITEC, PEX, PVC AND ABS) CAN NOT BE RUN EXPOSED UNLESS APPROVED BY CARLIN MANUFACTURING.
  8. WATER HEATER SHALL BE PERMANENTLY SECURED TO THE FLOOR AND OR THE WALL.

SYMBOL	DESCRIPTION
H	HOT WATER LINE
C	COLD WATER LINE
(R)	PRESSURE REGULATOR
(V)	VALVE, BRASS BALL
(T)	TEE
(E)	90° ELBOW
(F)	FLEX HOSE ASSEMBLY (S.S. BRAIDED MPT x FPT SWIVEL)
(Q)	QUICK DISCONNECT
(V3)	VALVE 3-WAY
(P)	PUMP
(R)	REDUCER
(CV)	CHECK VALVE
(WF)	WATER FILTRATION SYSTEM

<b>Kitchens To Go</b>		UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE IN INCHES TO LEAST FRACTION.	
WISCONSIN VETERAN'S HOME		FRACTIONS: 1/8, 1/4, 3/8, 1/2, 5/8, 3/4, 7/8	
DISH WASH UNIT		DIMENSIONS: 1/8, 1/4, 3/8, 1/2, 5/8, 3/4, 7/8	
SIZE	CAGE CODE	ENG. NO.	REV.
B		569P01-0-01	1
SCALE	DATE	REV. BY	SHEET
1:64			

UNIT NO.	CM-569	<b>CARLIN MANUFACTURING LLC</b>	
APPROVALS	DATE	FRESH WATER PLUMBING SCHEMATIC	
DRAWN: GSF	04-18-05	SIZE	CAGE CODE
CHECKED:		B	
DESIGN ACTIVITY:		ENG. NO.	REV.
REV:		569P01-0-01	1
		SCALE	1:64
		DATE	REV. BY