

Please note: This drawing shows a typical configuration of equipment and does not necessarily show the equipment currently installed in the unit. Verify the specific equipment currently in the unit with a KTG representative.

8 7 6 5 4 3 2 1

THE DESIGN AND DETAILS DISCLOSED HEREIN ARE THE EXCLUSIVE PROPERTY OF CARLIN MANUFACTURING LLC. AND SHALL NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR WRITTEN CONSENT OF CARLIN MANUFACTURING LLC. ©2005 CARLIN MANUFACTURING LLC.

REVISIONS				
DATE	REV	DESCRIPTION	DATE	APPROVED
	A	MOVED EQUIP.	04-25-05	

NOTES:


1. GAS LINES SHALL BE IN BLACK STEEL PIPE, SCHEDULE 40, UNLESS OTHERWISE SPECIFIED.
2. GAS LINES SHALL BE SUPPORTED WITH PIPE STRAPS TO WITHSTAND ON AND OFF-ROAD CONDITIONS.
3. SOLENOID VALVE TO BE CONNECTED TO EMERGENCY SHUT OFF VALVE AND FIRE SUPPRESSION SYSTEM.

D
C
B
A

D
C
B
A

HVAC
60,000 BTU

BOOSTER HEATER
195,000 BTU

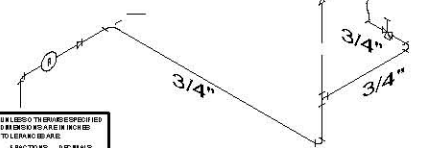

SYMBOL	DESCRIPTION
	VALVE, GAS
	TEE
	90° ELBOW
	REGULATOR
	FLEX TUBING ASSEMBLY
	SOLENOID VALVE
	HYDRASTATIC RELIEF

Kitchens To Go

WISCONSIN VETERAN'S HOME
DISH WASH UNIT

SIZE	CAGE CODE	ENG. NO.	REV.
B		569P04-0-01	1
SCALE	1:64		

UNIT NO.	CM-569	CARLIN MANUFACTURING LLC	
APPROVALS	DATE	LP GAS SCHEMATIC	
DRAWN	GSF	04-18-05	
CHECKED			
ENGR		SIZE	CAGE CODE
DESIGN ACTIVITY		B	569P04-0-01
REV.		SCALE	1:64

8 7 6 5 4 3 2 1